



LOT 37

LOT 245

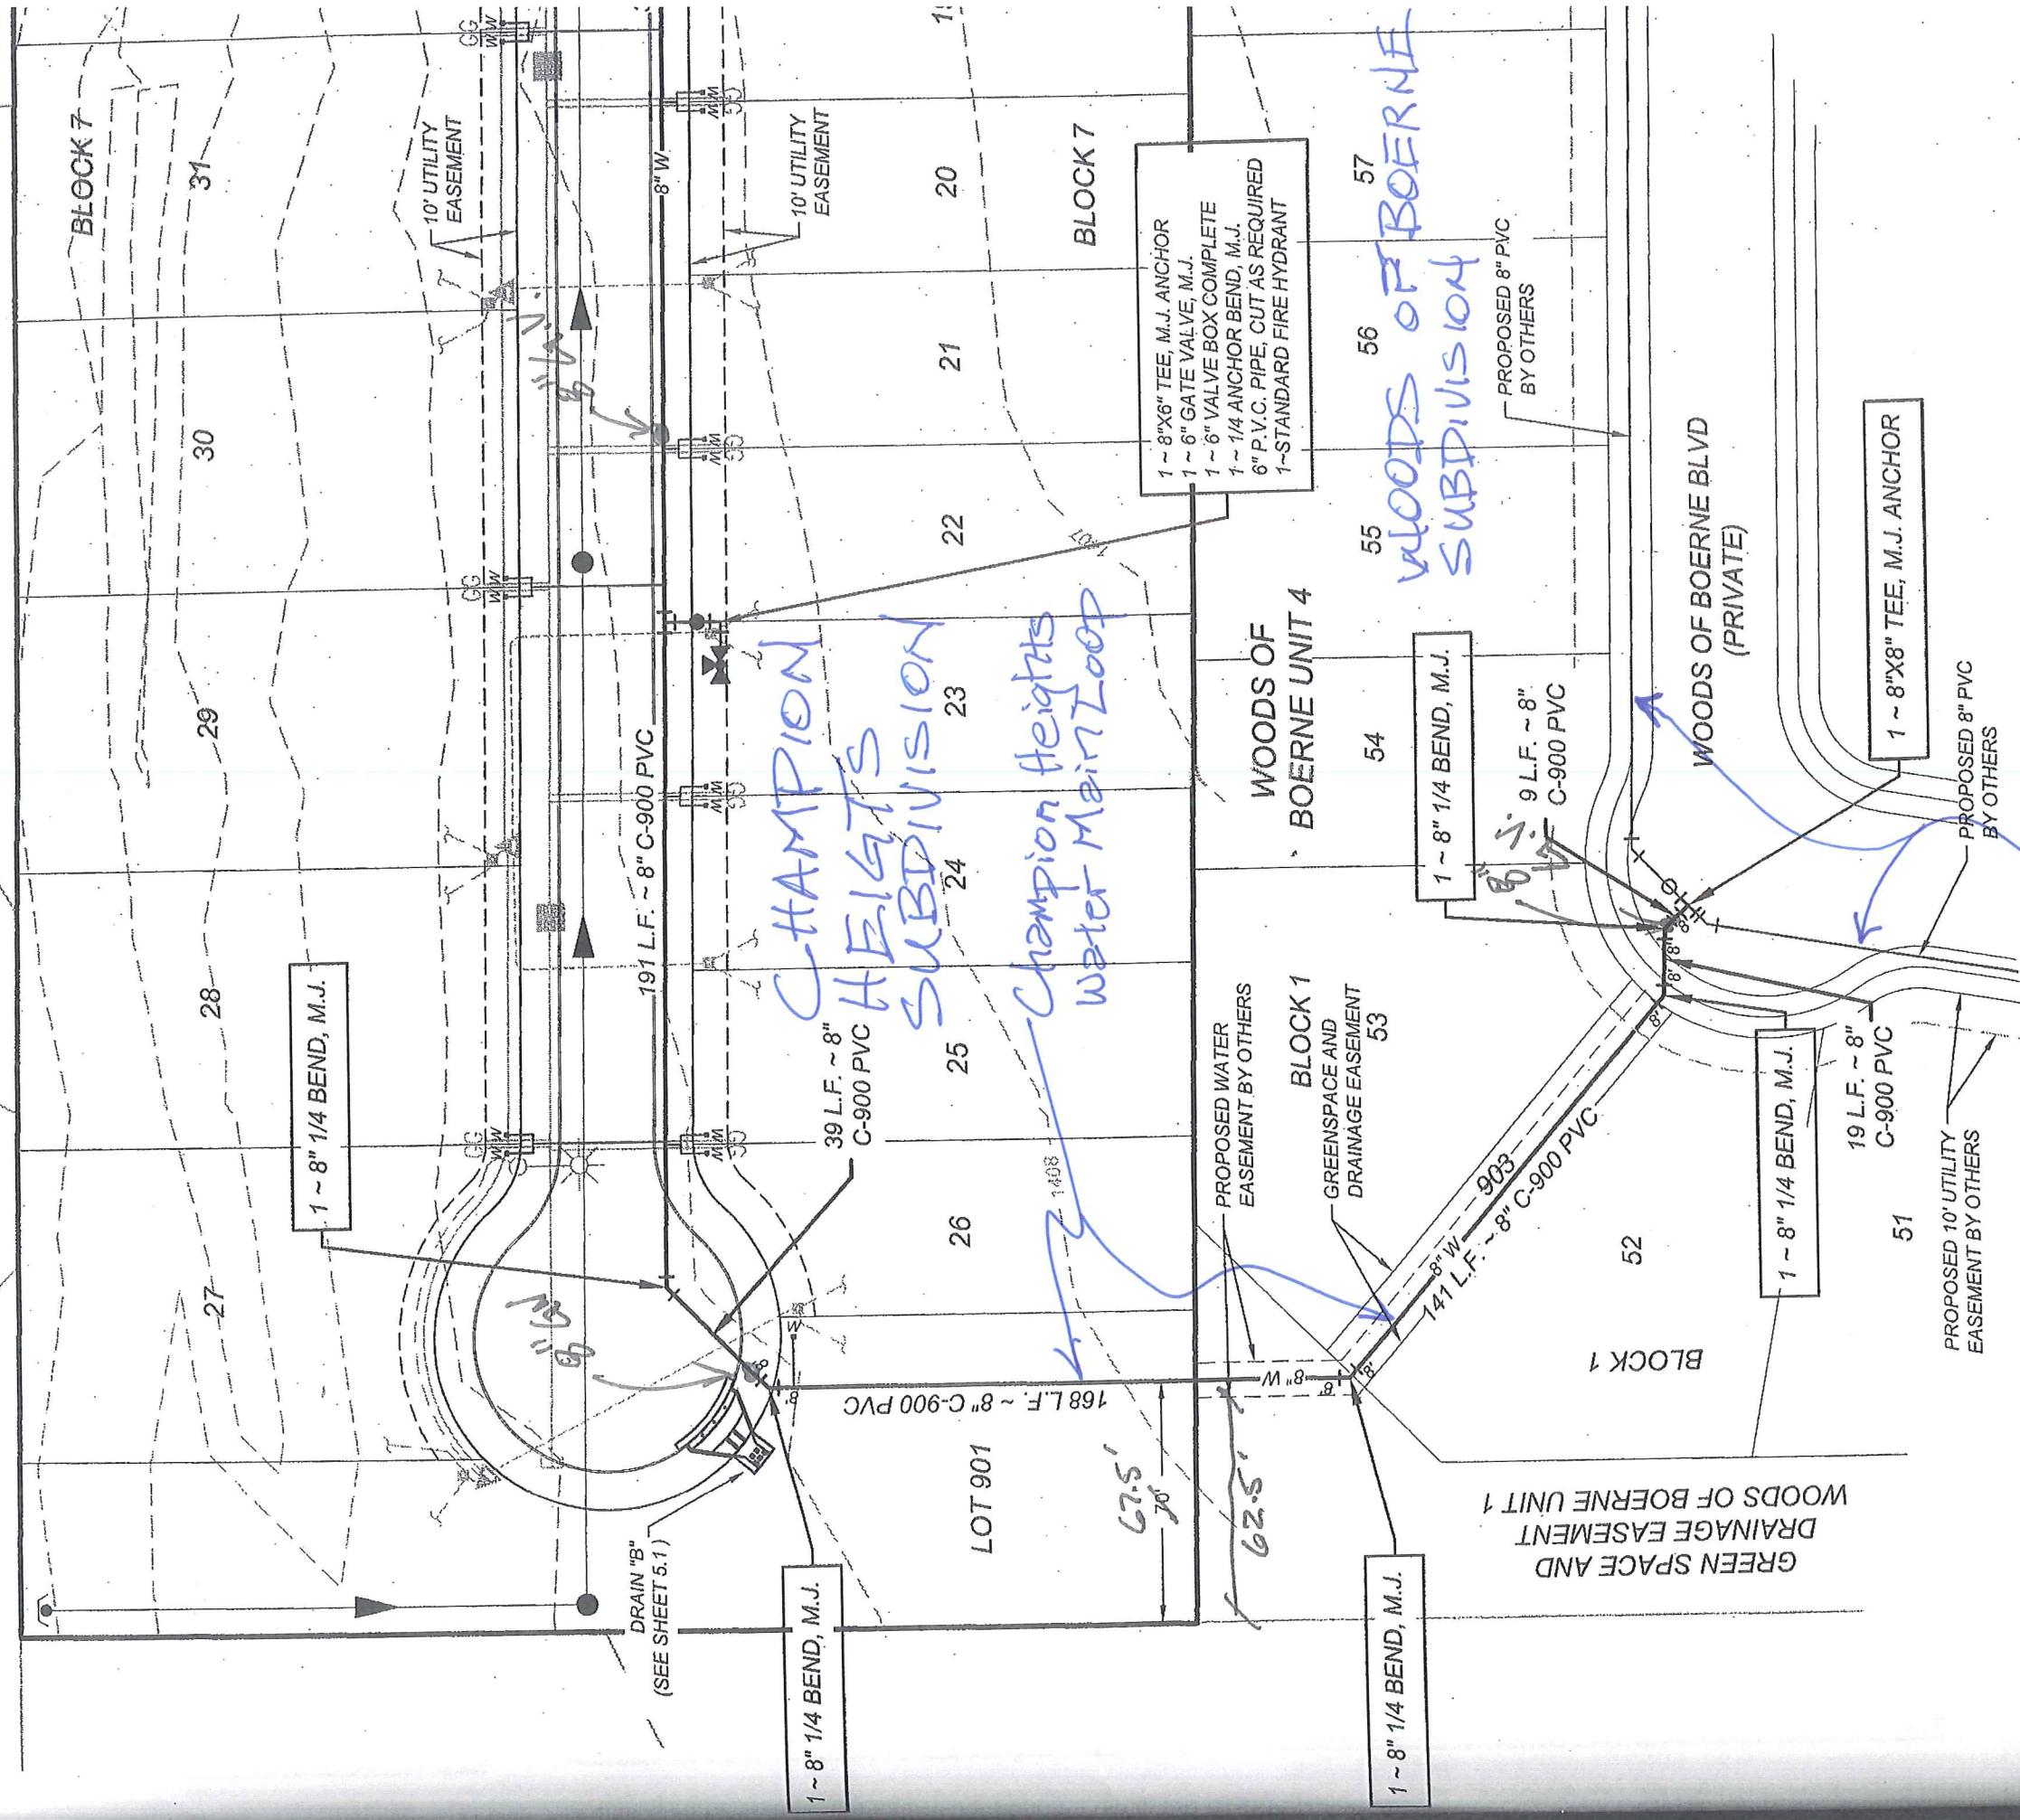

Woods of Boerne
Water Main Loop is
Internal

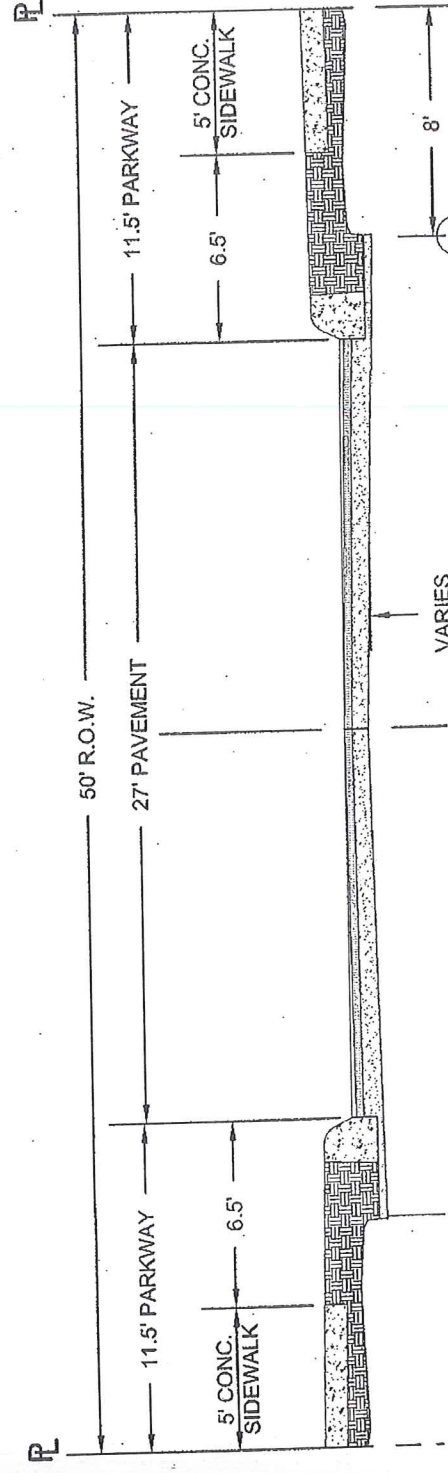

DISSINFECT WITH AWWA B30
CHLORINE COMPOUND