


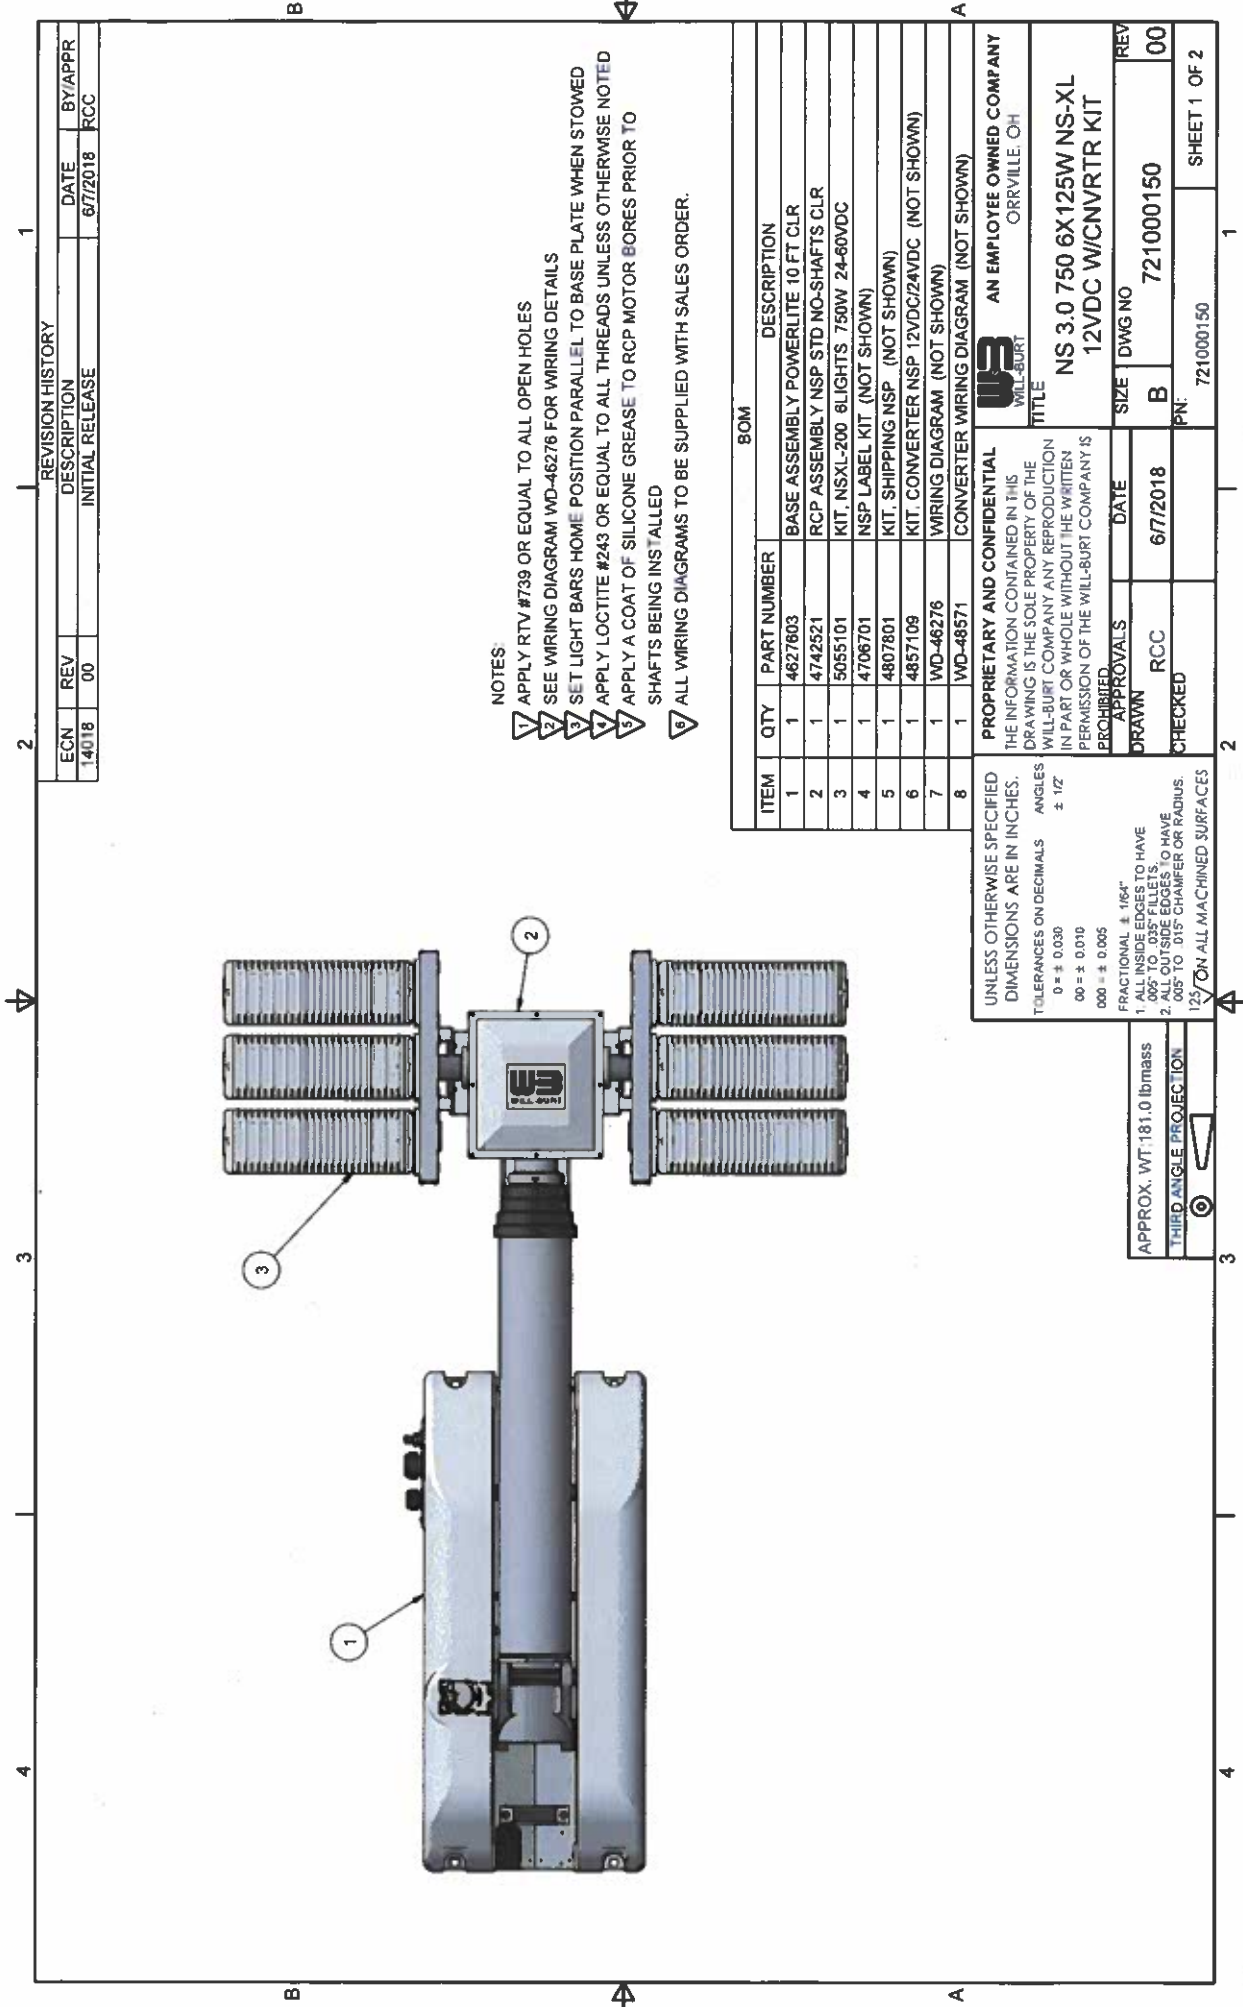

REVISION HISTORY			
ECN	REV	DESCRIPTION	DATE
14018	00	INITIAL RELEASE	6/7/2018
		BY/APPR	RCC

NOTES:

- 1 APPLY RTV #739 OR EQUAL TO ALL OPEN HOLES
- 2 SEE WIRING DIAGRAM WD-46276 FOR WIRING DETAILS
- 3 SET LIGHT BARS HOME POSITION PARALLEL TO BASE PLATE WHEN STOWED
- 4 APPLY LOCTITE #243 OR EQUAL TO ALL THREADS UNLESS OTHERWISE NOTED
- 5 APPLY A COAT OF SILICONE GREASE TO RCP MOTOR BORES PRIOR TO SHAFTS BEING INSTALLED
- 6 ALL WIRING DIAGRAMS TO BE SUPPLIED WITH SALES ORDER.

BOM	
ITEM	QTY
1	1
2	1
3	1
4	1
5	1
6	1
7	1
8	1

UNLESS OTHERWISE SPECIFIED, DIMENSIONS ARE IN INCHES.	
TOLERANCES ON DECIMALS	ANGLES
0 ± 0.030	± 1/2°
00 ± 0.010	
000 ± 0.005	
FRACTIONAL ± 1/64"	
1. ALL INSIDE EDGES TO HAVE 0.062" TO 0.35" FILLETS.	
2. ALL OUTSIDE EDGES TO HAVE 0.062" TO 0.15" CHAMFER OR RADIUS.	
125° ON ALL MACHINED SURFACES	
APPROX. WT: 181.0 lb/mass	
THIRD ANGLE PROJECTION	
PROPRIETARY AND CONFIDENTIAL	
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF THE WILL-BURT COMPANY. ANY REPRODUCTION IN PART OR WHOLE WITHOUT THE WRITTEN PERMISSION OF THE WILL-BURT COMPANY IS PROHIBITED.	
WILL-BURT AN EMPLOYEE OWNED COMPANY ORRVILLE, OH	
TITLE	
NS 3.0 750 6X125W NS-XL 12VDC W/CNVRTR KIT	
APPROVALS	DATE
DRAWN RCC	6/7/2018
CHECKED	
SIZE DWG NO	REV
B 721000150	00
PN: 721000150	SHEET 1 OF 2

